

Office Action Summary	Application No. 10/733,256	Applicant(s) CROSNIER ET AL.	
	Examiner Frederick C. Nicolas	Art Unit 3754	

-- The MAILING DATE of this communication appears on the cover sheet with the correspondence address --

Period for Reply

A SHORTENED STATUTORY PERIOD FOR REPLY IS SET TO EXPIRE 3 MONTH(S) OR THIRTY (30) DAYS, WHICHEVER IS LONGER, FROM THE MAILING DATE OF THIS COMMUNICATION.

- Extensions of time may be available under the provisions of 37 CFR 1.136(a). In no event, however, may a reply be timely filed after SIX (6) MONTHS from the mailing date of this communication.
- If NO period for reply is specified above, the maximum statutory period will apply and will expire SIX (6) MONTHS from the mailing date of this communication.
- Failure to reply within the set or extended period for reply will, by statute, cause the application to become ABANDONED (35 U.S.C. § 133). Any reply received by the Office later than three months after the mailing date of this communication, even if timely filed, may reduce any earned patent term adjustment. See 37 CFR 1.704(b).

Status

- 1) ☒ Responsive to communication(s) filed on the interview dated 1/22/2009.
- 2a) ☐ This action is **FINAL**. 2b) ☒ This action is non-final.
- 3) ☐ Since this application is in condition for allowance except for formal matters, prosecution as to the merits is closed in accordance with the practice under *Ex parte Quayle*, 1935 C.D. 11, 453 O.G. 213.

Disposition of Claims

- 4) ☒ Claim(s) 1-33 is/are pending in the application.
- 4a) Of the above claim(s) _____ is/are withdrawn from consideration.
- 5) ☒ Claim(s) 1-30 and 32 is/are allowed.
- 6) ☒ Claim(s) 31 and 33 is/are rejected.
- 7) ☐ Claim(s) _____ is/are objected to.
- 8) ☒ Claim(s) 1-33 are subject to restriction and/or election requirement.

Application Papers

- 9) ☐ The specification is objected to by the Examiner.
- 10) ☐ The drawing(s) filed on _____ is/are: a) ☐ accepted or b) ☐ objected to by the Examiner.
Applicant may not request that any objection to the drawing(s) be held in abeyance. See 37 CFR 1.85(a).
Replacement drawing sheet(s) including the correction is required if the drawing(s) is objected to. See 37 CFR 1.121(d).
- 11) ☐ The oath or declaration is objected to by the Examiner. Note the attached Office Action or form PTO-152.

Priority under 35 U.S.C. § 119

- 12) ☒ Acknowledgment is made of a claim for foreign priority under 35 U.S.C. § 119(a)-(d) or (f).
- a) ☒ All b) ☐ Some * c) ☐ None of:
1. ☒ Certified copies of the priority documents have been received.
2. ☐ Certified copies of the priority documents have been received in Application No. _____.
3. ☐ Copies of the certified copies of the priority documents have been received in this National Stage application from the International Bureau (PCT Rule 17.2(a)).

* See the attached detailed Office action for a list of the certified copies not received.

Attachment(s)

- | | |
|--|--|
| 1) <input type="checkbox"/> Notice of References Cited (PTO-892) | 4) <input checked="" type="checkbox"/> Interview Summary (PTO-413) |
| 2) <input type="checkbox"/> Notice of Draftsperson's Patent Drawing Review (PTO-948) | Paper No(s)/Mail Date. <u>1/22/2009</u> . |
| 3) <input type="checkbox"/> Information Disclosure Statement(s) (PTO/SB/08) | 5) <input type="checkbox"/> Notice of Informal Patent Application |
| Paper No(s)/Mail Date _____. | 6) <input type="checkbox"/> Other: _____. |

DETAILED ACTION

Claim Rejections - 35 USC § 102

1. The following is a quotation of the appropriate paragraphs of 35 U.S.C. 102 that form the basis for the rejections under this section made in this Office action:


A person shall be entitled to a patent unless –

(b) the invention was patented or described in a printed publication in this or a foreign country or in public use or on sale in this country, more than one year prior to the date of application for patent in the United States.

2. Claims 31,33 are rejected under 35 U.S.C. 102(b) as being anticipated by van der Heijden 6,220,483.

Van der Heijden discloses a pump for mounting on a receptacle as seen in Figure 1, which comprises a dispenser orifice (10), a pump body (see marked drawing below), the pump body including a spike (40), a moving body (50) being movable relative to the receptacle, including a pushbutton and defining with the pump body a pump chamber (5) of variable volume, the moving body including a skirt (4) defining a passage via which substance present in the chamber is delivered toward the dispensing orifice (col. 4, ll. 37-47), the skirt co-operating with the spike when the pump is at rest to isolate the inside of the skirt from the pump chamber as seen in Figure 1.

Art Unit: 3754

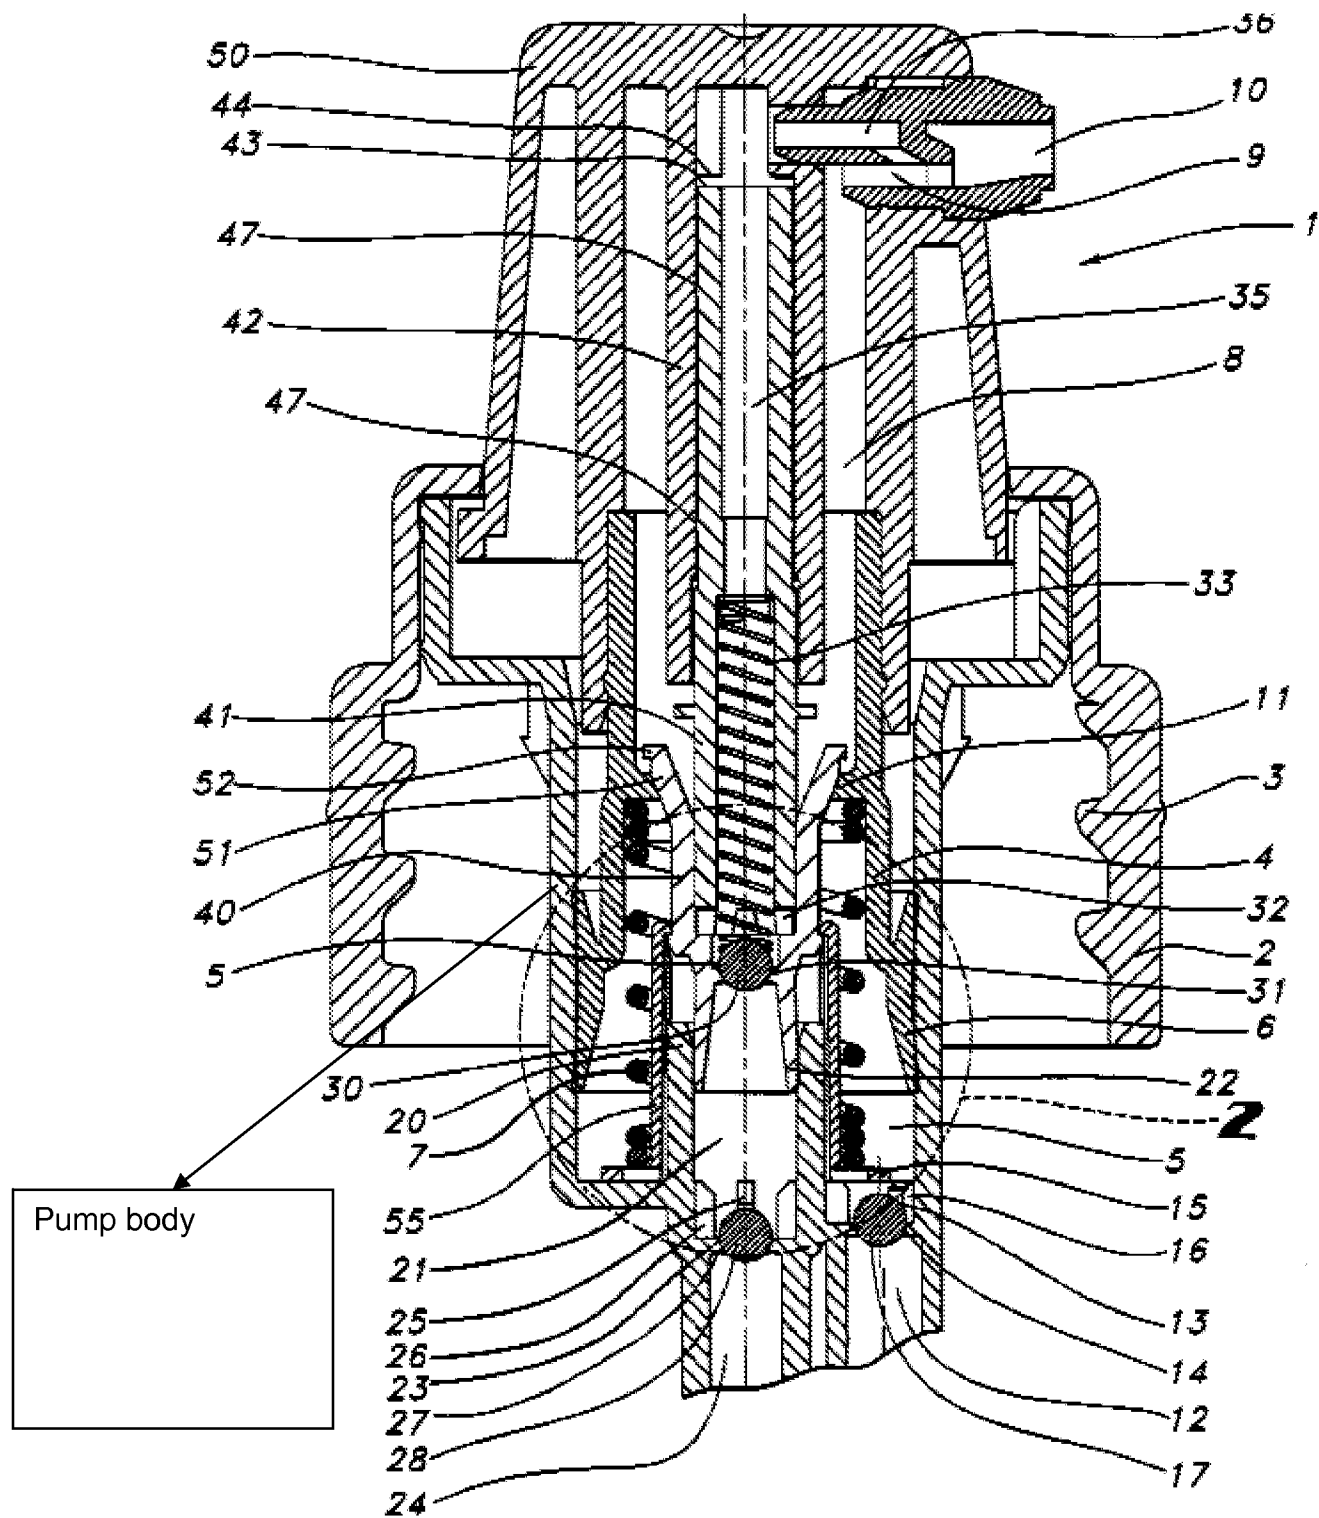

Allowable Subject Matter

3. Claims 1-30,32 are allowed.

Response to Arguments

4. Applicant's arguments filed 8/6/2008 have been fully considered but are moot in view of the new ground(s) or rejection.

Conclusion

5. Any inquiry concerning this communication or earlier communications from the examiner should be directed to Frederick C. Nicolas whose telephone number is (571)-272-4931. The examiner can normally be reached on Monday - Friday from 9:00 AM to 5:00 PM.

If attempts to reach the examiner by telephone are unsuccessful, the examiner's supervisor, Kevin P. Shaver can be reached on (571)-272-4720. The fax phone number for the organization where this application or proceeding is assigned is 571-273-8300.

Art Unit: 3754

Information regarding the status of an application may be obtained from the Patent Application Information Retrieval (PAIR) system. Status information for published applications may be obtained from either Private PAIR or Public PAIR. Status information for unpublished applications is available through Private PAIR only. For more information about the PAIR system, see <http://pair-direct.uspto.gov>. Should you have questions on access to the Private PAIR system, contact the Electronic Business Center (EBC) at 866-217-9197 (toll-free). If you would like assistance from a USPTO Customer Service Representative or access to the automated information system, call 800-786-9199 (IN USA OR CANADA) or 571-272-1000.

/Frederick C. Nicolas/
Primary Examiner, Art Unit 3754